


35kV TERMINATION selection guide

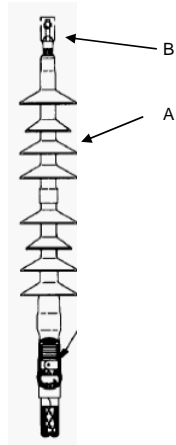


AL CORE 345 MIL JACKETED CONCENTRIC NEUTRAL CONDUCTOR

SIZE	Assembly #	STINGER		1-HOLE 1/2"		2-HOLE NEMA		4-HOLE NEMA	
		A	B *	A	B*	A	B*	A	B*
1/0 SOL	7663-S-8-9-AL-WF-(B)	7663-S-8	SC0001	7663-S-8	40029	7663-S-8	TBD	7663-S-8	TBD
1/O	7663-S-8-9-AL-WF-(B)	7663-S-8	SC0001	7663-S-8	40033	7663-S-8	TBD	7663-S-8	TBD
2/O	7664-S-8-12-AL-WF-(B)	7664-S-8	SC0002	7664-S-8	40037	7664-S-8	40137	7664-S-8	TBD
3O	7664-S-8-13-AL-WF-(B)	7664-S-8	SC0003	7664-S-8	40041	7664-S-8	40141	7664-S-8	TBD
4O	7664-S-8-14-AL-WF-(B)	7664-S-8	SC0004	7664-S-8	40045	7664-S-8	40145	7664-S-8	TBD
35O	7665-S-8-15-AL-WF-(B)	7665-S-8	TBD	7665-S-8	40056	7665-S-8	40156	7665-S-8	TBD
500	7665-S-8-9-AL-WF-(B)	7665-S-8	TBD	7665-S-8	TBD	7665-S-8	40176	7665-S-8	TBD
750	7666-S-8-9-AL-WF-(B)	7666-S-8	TBD	7666-S-8	TBD	7666-S-8	40172	7666-S-8	TBD
1000	7666-S-8-9-AL-WF-(B)	7666-S-8	TBD	7666-S-8	TBD	7666-S-8	40178	7666-S-8	AL28-4N
1250	7666-S-8-9-AL-WF-(B)	7666-S-8	TBD	7666-S-8	TBD	7666-S-8	AL29-2N	7666-S-8	AL29-4N

TBD= DETERMINED AT TIME OF ORDER

* = ALTERNATE LUGS APPLICABLE IN MOST CASES

DISSIMILAR TERMINATION LENGTH CAUTION

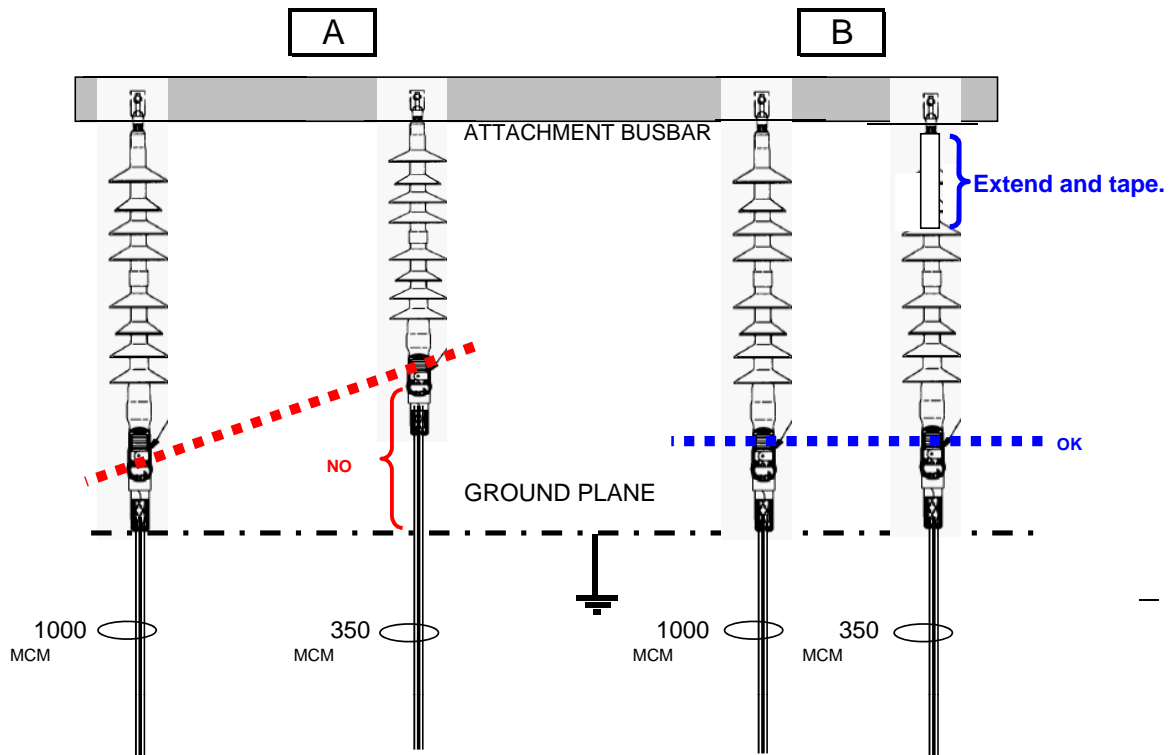

Dia A

Do NOT place parallel feeders of different cable sizes into a Position in which there is a different distance to ground. (dia A)

Dia B

Place terminations in same ground plane to eliminate potential for ARcing to occur by extending length of upper insulatinon and taping